

WATER SERVICE LINE INVENTORY


City of Dassel



The City of Dassel is working to complete an inventory of all water service lines within the system. The goal of the inventory is to identify the material type of every service line. We are asking water customers to help with the process and perform a material survey.

You can identify your pipe material by checking your household water services connections inside your home, typically located in your basement. See photo below for reference.

What is a service line? A service line is the pipe connecting the water main to the interior plumbing in a building.

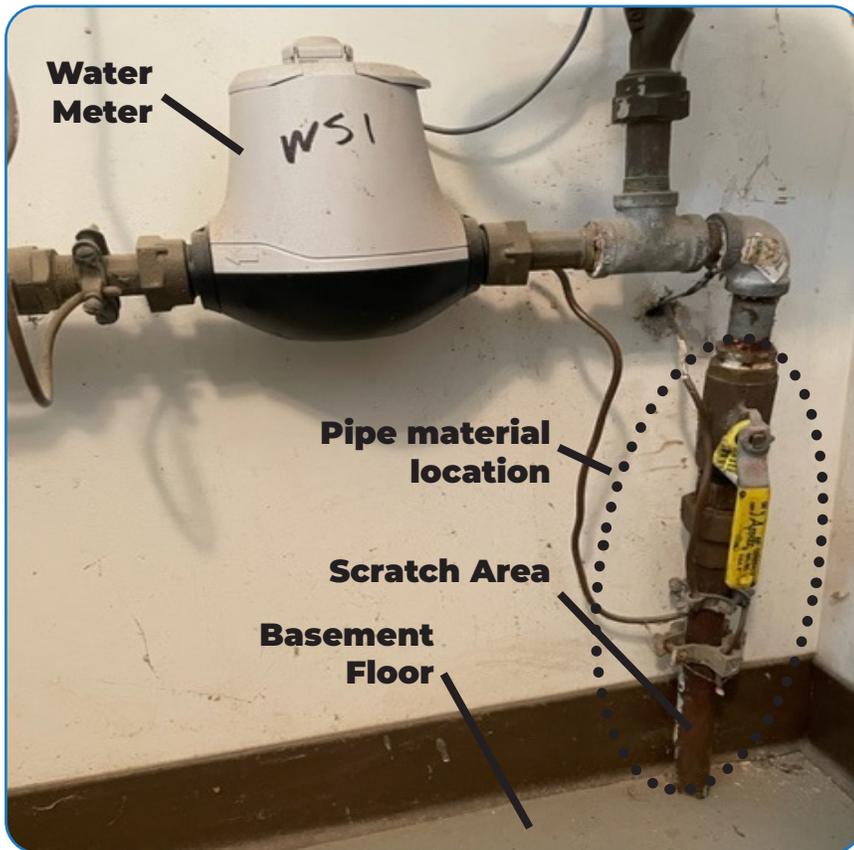

WE NEED YOUR HELP!

We are asking residents to perform a water service line material survey to ensure the most accurate inventory. Please fill out the inventory form on the backside of this notice and return to City Hall.



If you have any questions, please call Kyle Moy at **612-716-0686**.

Please respond by November 8, 2024. A lack of response will prompt contact by City or Bolton & Menk Staff to schedule a visit to visually verify the water service and determine material type.

health.state.mn.us/communities/environment/water/lsrprogram.html

Types of Water Pipes



Use the guide below to determine your water pipe material.

LEAD

A dull, silver-gray color that is easily scratched with a coin. Use a magnet to detect the material – strong magnets will not cling to lead pipes.



GALVANIZED

A dull, silver-gray color. Use a magnet to detect the material – strong magnets will typically cling to galvanized pipes.



PLASTIC

Blue or black pipe.



COPPER

The color of a penny.



After you determine your pipe material:

- Take the survey found below and return to city hall **with an attached photo** of the water service pipe entering your home through the floor, foundation, or ground. **(460 3rd St N, Dassel, MN 55325).**

If you have any questions, please call Kyle Moy at **612-716-0686**.

RESIDENT INFORMATION

First Name: _____ Last Name: _____

Phone Number: _____ Email: _____

Property Address: _____

PIPE INFORMATION

Based on the appearance, testing, or existing records, please select the appropriate material of your service line.

Material: Lead Galvanized Plastic Copper Unknown

How did you determine the material of your service line?

Source Information: Visual Inspection Plumbing Records Scratch Test